



SOUND TRANSMISSION LOSS TEST REPORT NO. TL13-202

CLIENT: **ClarkDietrich Building Systems**
9100 Centre Pointe Drive, Suite 210
West Chester, OH 45069

Page 1 of 2
28 February 2013

TEST DATE: 26 February 2013

INTRODUCTION

The methods and procedures used for each test conform to the provisions and requirements of ASTM E 90-09, *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions* and ASTM E2235-04^{e1}, *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*. Copies of the test standard are available at www.astm.org. The test chamber source and receiving room volumes are 204 and 148.4 cubic meters respectively. Western Electro-Acoustic Laboratory is accredited by the United States Department of Commerce, National Institute of Standards and Technology under the National Voluntary Accreditation Program (NVLAP) Lab Code 100256-0 for this test procedure. This test report relates only to the item(s) tested. This report must not be used to claim product certification, approval, or endorsement by WEAL, NVLAP, NIST or any agency of the federal government.

DESCRIPTION OF TEST SPECIMEN

The test specimen was a wall assembly constructed from metal studs and Type X gypsum board. The metal studs were 92 mm (3-5/8 inch) ClarkDietrich™ Building Systems ProSTUD 30 mil and were spaced at 610 mm (24 inches) O.C. The head and sill tracks were also 92 mm (3-5/8 inch) ClarkDietrich ProSTUD 30 mil. The frame was isolated from the test opening with 6.4 mm (1/4 inch) neoprene pads. Full width Owens Corning R-13 un-faced fiberglass batts, 89 mm (3-1/2 inch) thick, were installed in the stud spaces. On the source room side, one layer of 15.9 mm (5/8 inch) thick USG Type X gypsum board was screwed to the studs at 203 mm (8 inches) O.C. around the perimeter and 305 mm (12 inches) O.C. in the field using 28.6 mm (1-1/8 inch) drywall screws. On the receiving room side, two layers of 15.9 mm (5/8 inch) thick USG Type X gypsum board was screwed to the studs at 203 mm (8 inches) O.C. around the perimeter and 305 mm (12 inches) O.C. in the field using 28.6 mm (1-1/8 inch) drywall screws on the first layer and 50.8 mm (2 inch) drywall screws on the second layer. All gypsum board was oriented vertically and the joints were staggered on opposite sides of the wall and between layers. On both sides, the joints and perimeters were sealed with a bead of caulking and metal foil tape. All screw heads were covered with metal foil tape. The overall dimensions of the wall assembly were 2.44 m (96 inches) wide by 2.44 m (96 inches) high by 140 mm (5-1/2 inches) thick. The overall weight of the assembly was estimated to be 218 kg (482 lbs) for a calculated surface density of 36.7 kg/m² (7.52 lbs./ft²).


RESULTS OF THE MEASUREMENTS

One-third octave band sound transmission loss values are plotted and tabulated on the attached sheet. ASTM minimum volume requirements are met at 80 Hz and above. The Outdoor-Indoor Transmission Class rating determined in accordance with ASTM E 1332-10a was OITC-33. The Sound Transmission Class rating determined in accordance with ASTM E 413-10 was STC-40.

Approved:


Respectfully submitted,
Western Electro-Acoustic Laboratory


Gary E. Mange
Laboratory Director


Raul Martinez
Acoustical Test Technician

WESTERN ELECTRO-ACOUSTIC LABORATORY

Report No. TL13-202

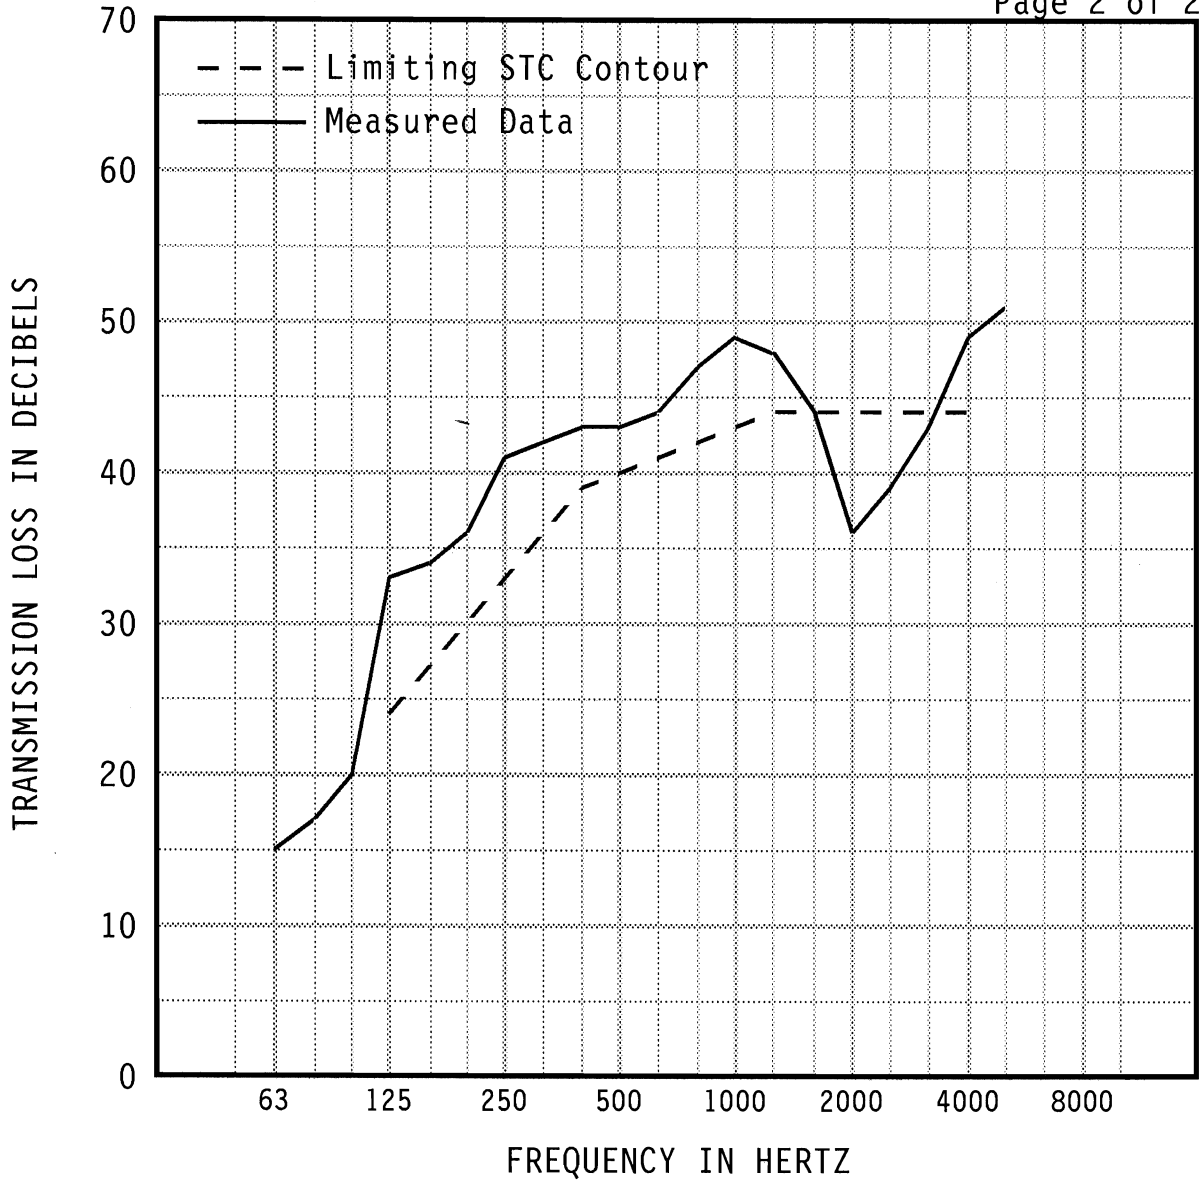

1/3 OCT BND CNTR FREQ	63	80	100	125	160	200	250	315	400	500
TL in dB	15	17	20	33	34	36	41	42	43	43
95% Confidence in dB deficiencies	1.42	1.92	2.07	1.47	0.89	0.76	0.80	0.52	0.36	0.38
1/3 OCT BND CNTR FREQ	630	800	1000	1250	1600	2000	2500	3150	4000	5000
TL in dB	44	47	49	48	44	36	39	43	49	51
95% Confidence in dB deficiencies	0.29	0.44	0.38	0.39	0.36	0.56 (0)	0.55 (8)	0.31 (5)	0.32 (1)	0.50

EWR	OITC	Specimen Area: 64 sq.ft. Temperature: 69.1 deg. F Relative Humidity: 35 % Test Date: 26 February 2013	STC 40 (14)
46	33		

Report must be distributed in its entirety except with written authorization from Western Electro-Acoustic Laboratory

