


---

Design Number CD/NSMF 120-03  
HEAD-OF-WALL JOINT SYSTEM  
ClarkDietrich™ Building Systems  
Trakloc® Steel Framing System  
ASTM E 1966 – 2 hr  
CAN/ULC-S115 – FTH 2 hr  
ASTM E 1399/ASTM E 1966 – Cycling:  
Class IV – Combined  
Rated for ± 18.25% vertical movement

---

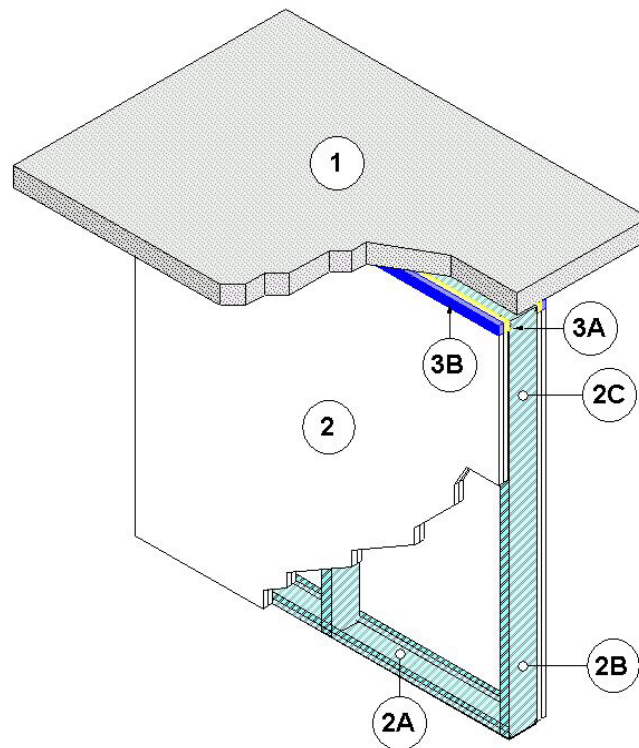

1. FLOOR/CEILING ASSEMBLY – The floor/ceiling assembly consists of the following:

A. Concrete – Poured-in-place normal weight concrete (approximately 150 pcf and nominally 2000 psi) nominally 4.5 in. deep at its minimum thickness with steel rebar reinforcement.

2. WALL ASSEMBLY – Non-loadbearing wall assembly positioned perpendicular to the floor ceiling assembly (Item 1) and consisting of the following elements:

A. CERTIFIED COMPANY:  
ClarkDietrich™ Building Systems

CERTIFIED PRODUCT: Track

MODEL: 362TTS137-18

Tracks – Use two “C-shaped” roll formed nominal 0.0179 in. minimum thick steel tracks with nominal measurements 3-5/8 in. wide with two 1-3/8 in. vertical legs. Use nominal 3/16 in. diameter, 1-1/4 in. long, hex head concrete screws, to attach steel tracks. Attach one track to the bottom of floor/ ceiling

assembly (Item 1) and attach the bottom track to the top of the lower floor/ceiling assembly (Item 1) aligned plumb with the top track.

B. CERTIFIED COMPANY:  
ClarkDietrich™ Building Systems

CERTIFIED PRODUCT:  
Telescoping Stud Deflection

MODEL: 362TSD125-18 and  
362TSE125-18

Studs – Use “C-shaped” roll formed nominal 0.179 in. minimum thick telescoping stud assembly nominally measuring 3-5/8 in. wide with two 1-3/8 in. vertical legs. Telescoping stud deflection consists of a 362TSD125-18 stud and a 362TSE125-18 extension stud inserted into the stud. Twist-and-lock telescoping stud assembly into the steel tracks (Item 2A) at nominal 24 in. on center (oc). No fasteners are required to secure the telescoping stud assembly to the steel floor tracks and ceiling runners (Item 2A).

C. Gypsum Board – Affix two layers of Type X 5/8 in. thick gypsum board to each side of the assembly. Attach base layer of Type X 5/8 in. thick gypsum board to each side of the tracks (Item 2A) and studs (Item 2B) using #8 1 in. long bugle head screws spaced nominally 16 in. oc in the field and around the perimeter. Affix face layer of Type X 5/8 in. thick gypsum board to each side of the tracks (Item 2A) and studs (Item 2B) using #8 1-5/8 in. bugle head screws spaced nominally 16 in. oc in the field and around the perimeter. Stagger face screws 8 in. from the base screws. Place no screws nominally 4 in. from the top of the track (Item 2A) through the Type X 5/8 in. thick gypsum board. Create a nominal 1 in. head of wall joint at the top of the assembly by cutting and positioning

the Type X 5/8 in. thick gypsum board shorter than the height between the steel tracks (Item 2A).

3. JOINT TREATMENT – Maximum 1 in. joint.

A. Joint Packing Material – Fill the joint created between the flute packing material and the top edge of the Type X 5/8 in. thick gypsum board (Item 2C) with a foam backer rod cut into filler strips nominally measuring 3/4 in. less in depth than the joint. Make the surface of the trapezoidal shape flush recessed surface with the filler strip creating a 3/4 in. recess.

B. CERTIFIED COMPANY: 3M  
Company

CERTIFIED PRODUCT: 3M Fire  
Barrier™ Joint Sealant

MODEL: Interam™ FireDam™ 150+

Fill, Void or Cavity Material – Fill the recess with sealant nominally measuring 3/4 in. thick. Trowel-apply sealant over all of the flute packing material and the joint packing material overlapping the sealant onto the Type X 5/8 in. thick gypsum board (Item 2C) at least 1 in.